

LCD Instruction Manual



LCD function

The LCD module is used for field adjustment to fine tune all the parameter settings before measuring pressure and temperature. The internal and external buttons can be utilized in safe or hazardous areas.

Product with LCD



The LCD is wired directly into the terminals, which can be viewed through the lens

Opening in safe area



Internal LCD buttons function in safe areas, open the cover, use the internal buttons for programming and operation

Button operation hazardous area




External button operation in dangerous area, slide open the nameplate, use the external buttons for programming and operation


LCD Operation

For example, factory setting parameters; pressure range -10~100kPa, display unit kPa, operate in the atmosphere.

Set PV=0

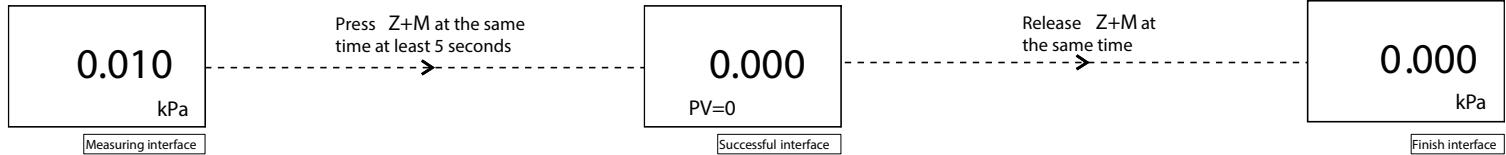


Full range adjustment

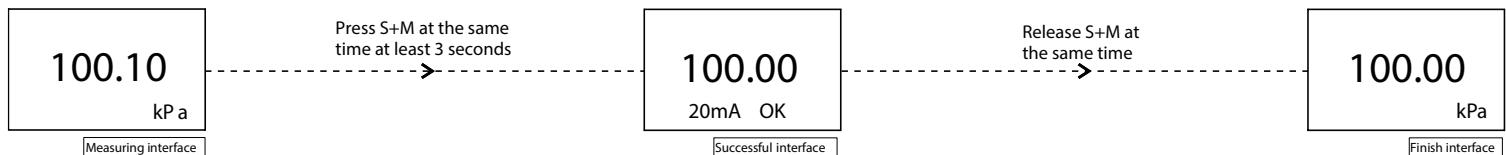


Factory reset

Option 1:

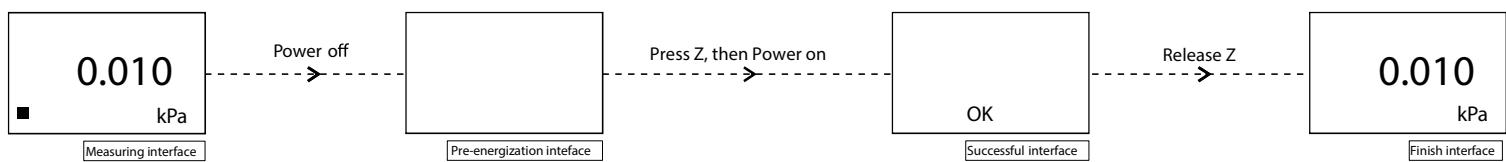

Option 2:

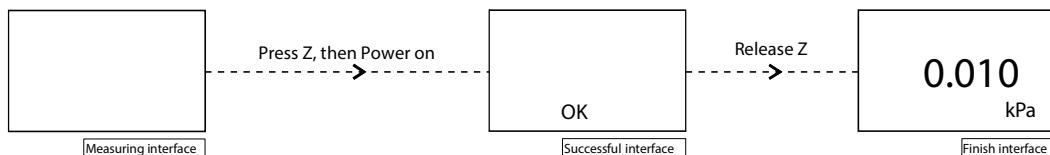


Temperature sensor unit switching:




LCD Instruction Manual




Detailed Operating Instructions

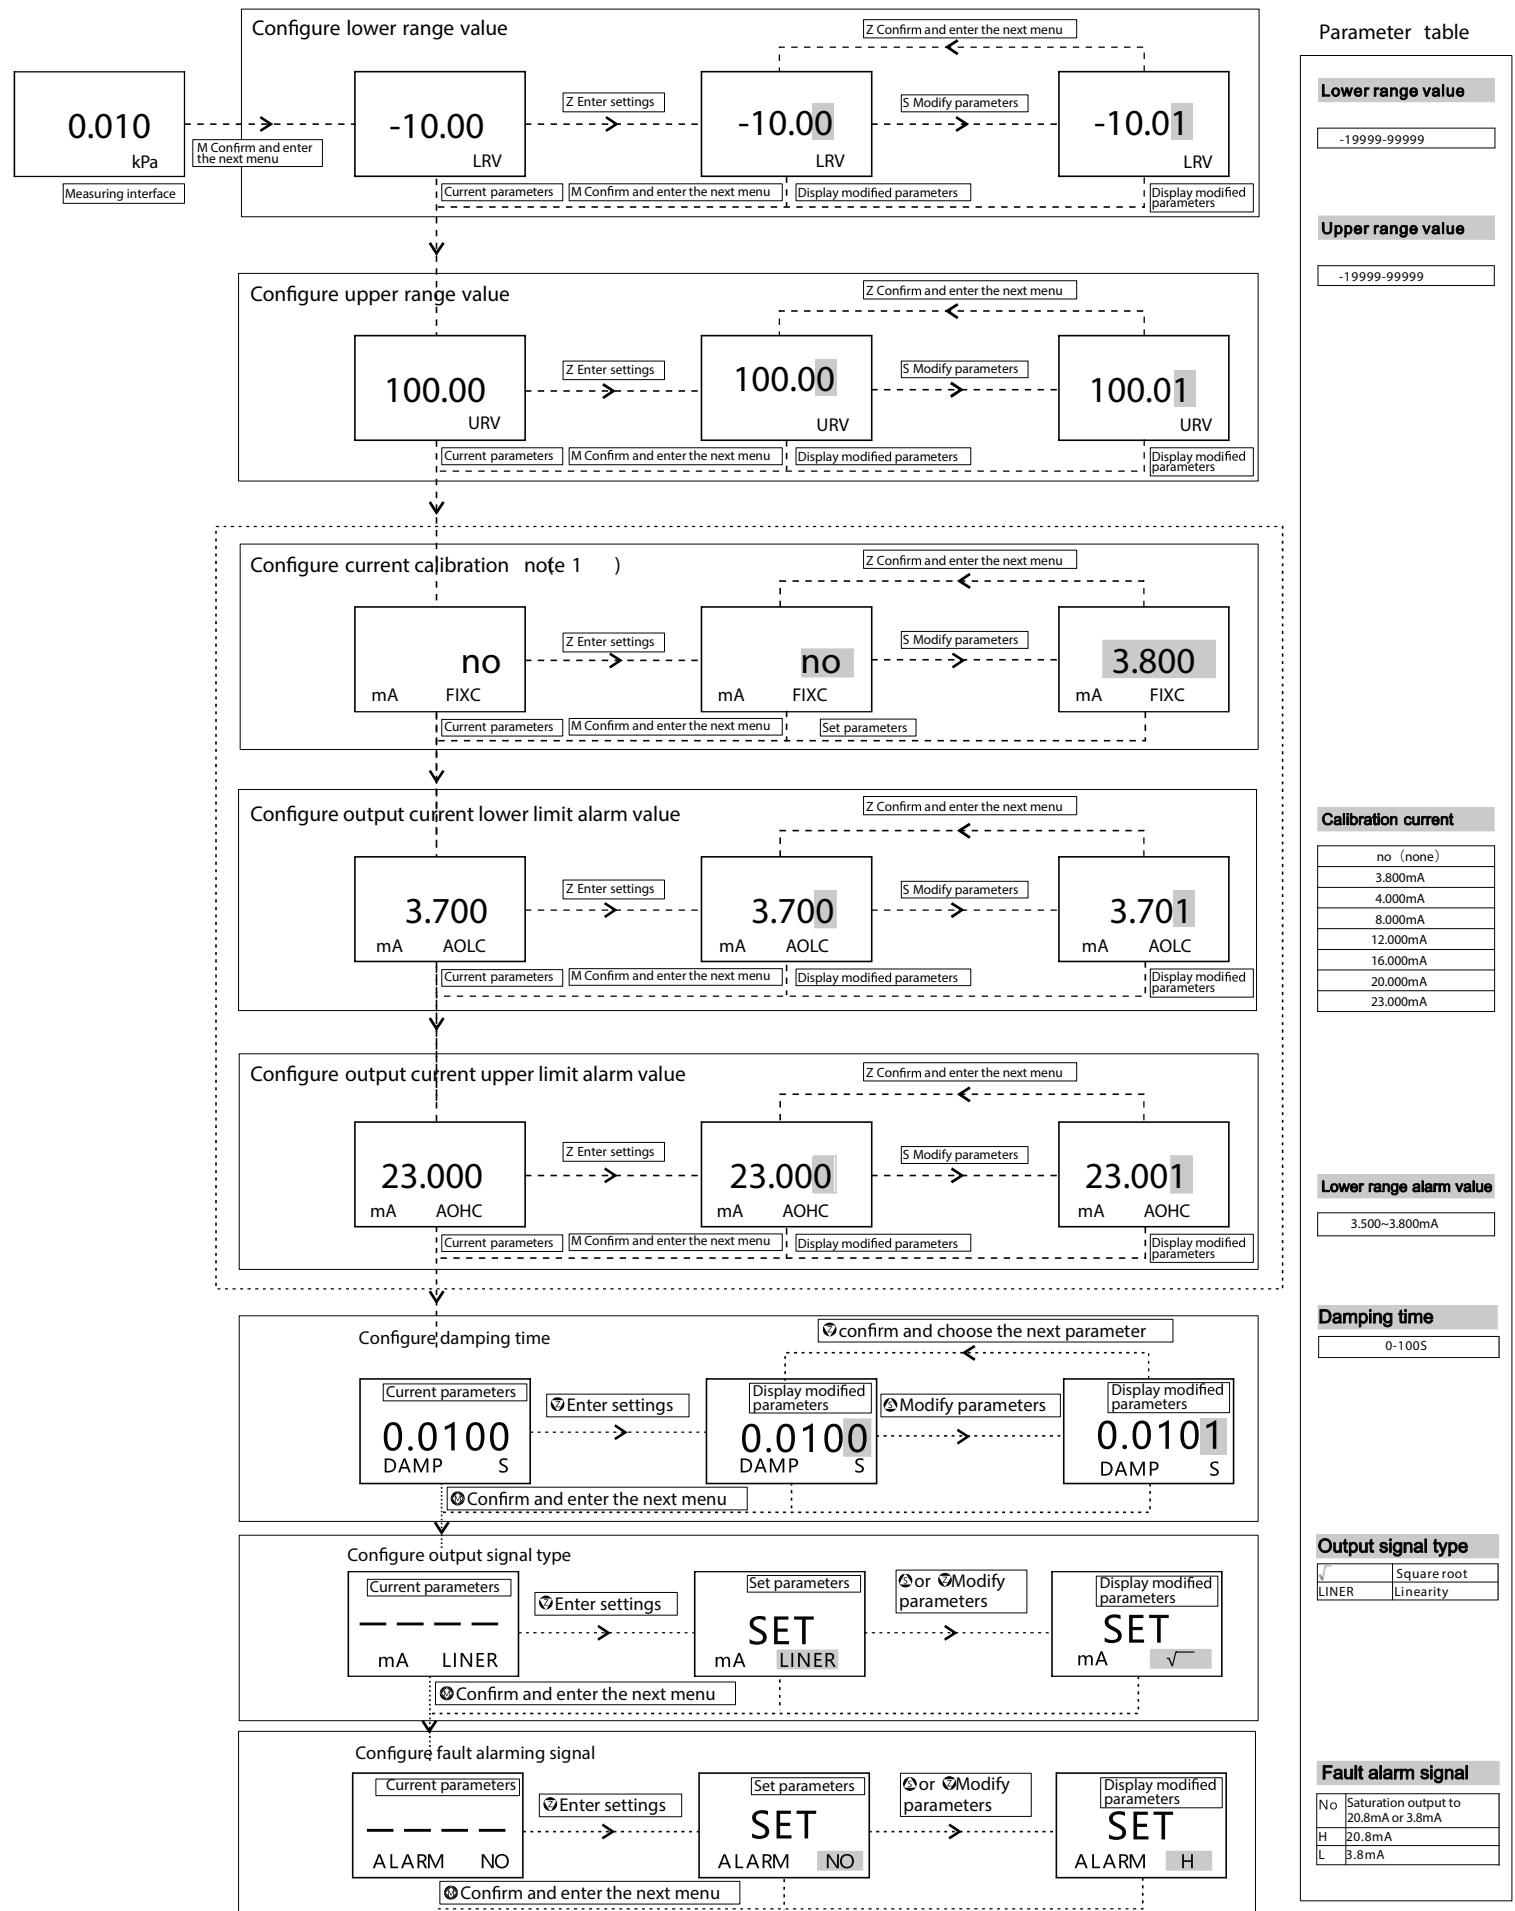

LCD Instruction Manual

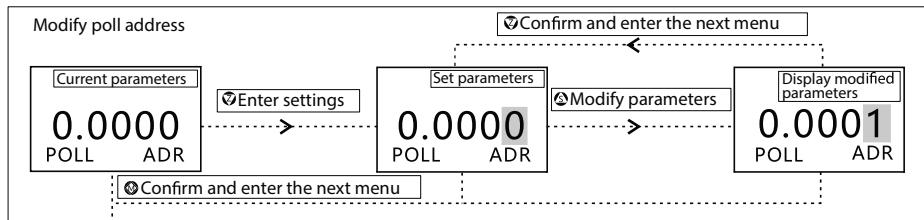


Optional address 0-15
0: Broadcast address
1-15: Non-broadcast address
(fixed analog output to 4mA)

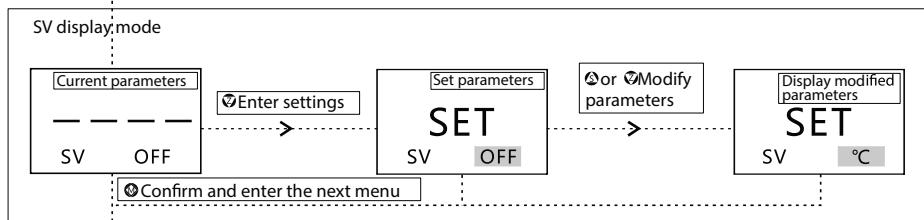


Display mode

OFF	None
°C	Celsius
°F	Fahrenheit
K	Kelvin

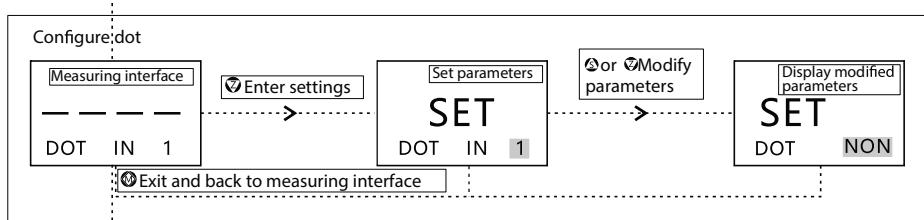


Dot options

NON	No decimals
1	Max one decimals
2	Max two decimals
3	Max three decimals

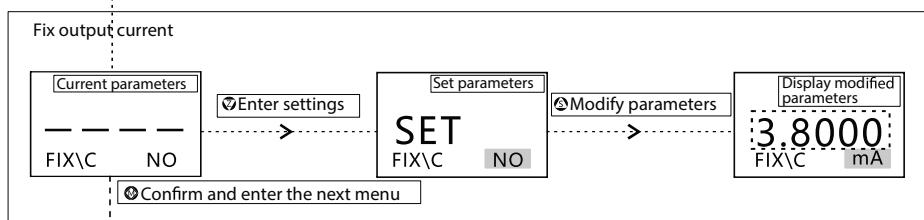


Loop current output

NO	Not fixed
3.8000	Fixed to 3.8mA
4.0000	Fixed to 4mA
8.0000	Fixed to 8mA
12.000	Fixed to 12mA
16.000	Fixed to 16mA
20.000	Fixed to 20mA
20.800	Fixed to 20.8mA

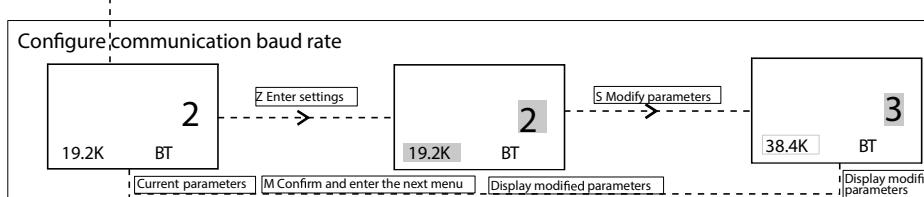

Upper range alarm value

20.800~24.000mA

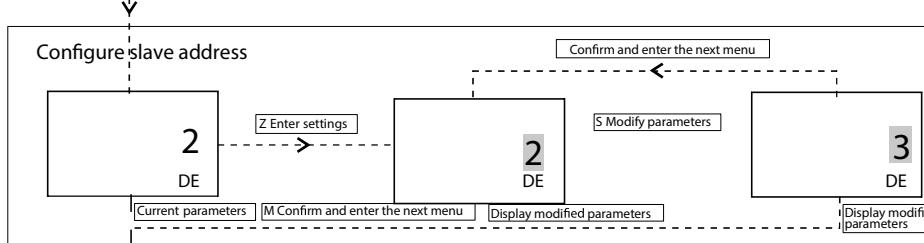


Communication baud rate

0	4.8K
1	9.6K
2	19.2K
3	38.4K
4	57.6K
5	115.2K

Slave address

1~247

LCD Instruction Manual

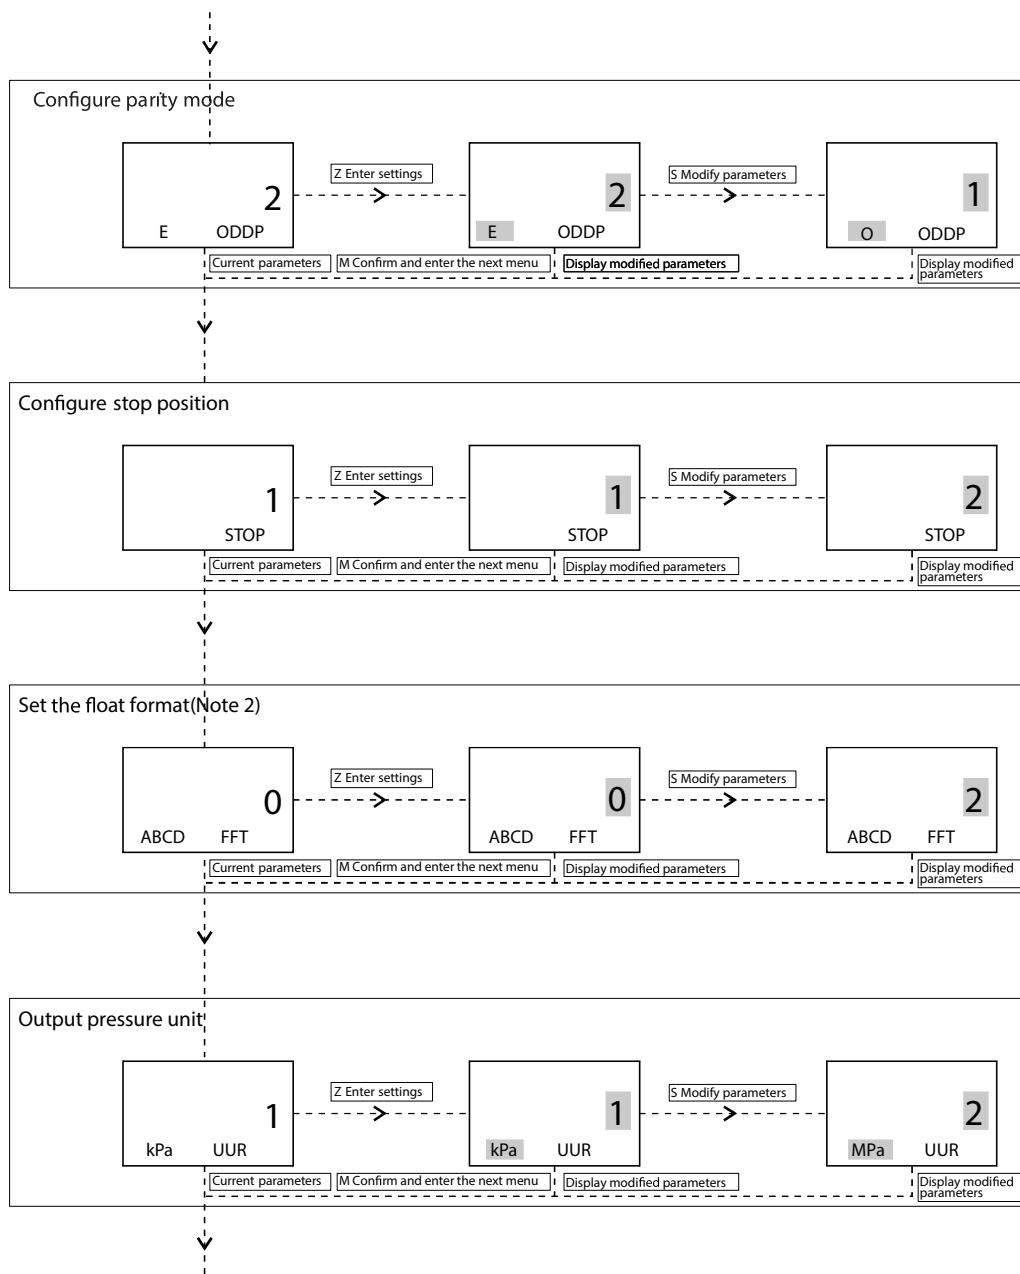

Parameters table

Configure parity mode	
0	N No
1	O ODD Parity
2	E Even parity

Stop position

1	1 Stop position
2	2 Stop position

Float format

0	ABCD
1	CDAB
2	BADC
3	DCBA

Pressure unit

Value	Unit
0	None
1	kPa
2	Mpa
3	Pa
4	bar
5	mbar
6	psi
7	mh2o@4C
8	mmH2O@4C
9	cmH2O@4C
10	inH2O@4C
11	ftH2O@4C
12	cmHg@0C
13	mmHg@0C
14	inHg@0C
15	kg/cm2
16	g/cm2
17	Torr
18	Atm
19	m
20	mm
21	osi
22	psf

Attention! Products without 4-20mA output, FIXC, AOLC, AOHC do not display.

Note 1: FIXC is to control fixed current output of products, to check whether output circuit of product current is normal. Modify fixed current value by pressing S key and confirm with Z key.

Note 2: The float format parameter is used for the device output pressure/temperature float data format, the factory default ABCD.